ProZone

Submittal Sheet

Model Pro211P

Number of Zones
2 Zones

Compatible Equipment
Gas/electric equipment with 1-stage heating and 1-stage cooling.

A2L Leak Detection
Monitors equipment A2L Leak Detection output.

Compatible Zone Thermostats
Any 24VAC heat/cool thermostat with W, Y and G outputs in Zone1 and 2.

Leaving Air Temperature Sensor
Mode TS2B 2-wire, 10K ohm sensor.

Automatic Bypass Control
Bypass using external modulating bypass damper controlled by panel or bypass using modulating non-calling zone damper controlled by panel.

Bypass Damper
Model R80ZJ-XX round modulating damper or RT80ZJ rectangular modulating damper.

Zone Dampers
Model R80ZJ-XX round modulating damper or RT80ZJ rectangular modulating damper. Actuators use solid state motor control for long life.

Display
On panel, 2x16 character LCD display with keypad.

Operating Temperature
-20 to 160ºF

Operating Humidity
0 to 90% non-condensating.

Wiring
18 or 20 gage thermostat wire.

Power
18 to 30VAC, 60Hz, 40VA transformer.

JOB _____

ARCHITECT _____

ENGINEER _____

CONTRACTOR _____

LOCATION _____

DATE _____

SUBMITTED BY _____

	Model Number	Qty
Panel	Pro211P	
Zone Thermostats		
Zone Dampers		
Bypass Damper		
LAT Sensor		
Transformer, 24VAC,40VA		

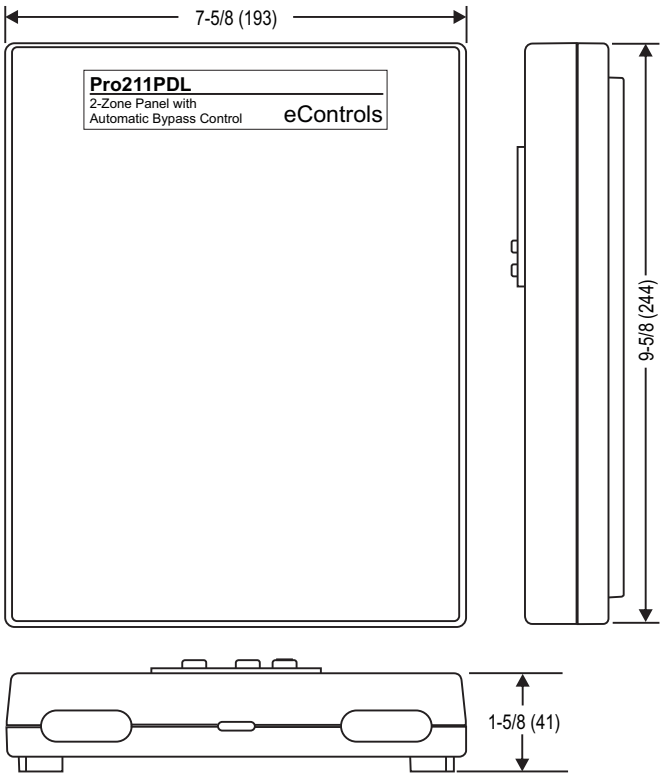

eControls

26072 Merit Circle #110 / Laguna Hills, CA 92653
949-916-0945 Fax 949-458-8502 www.eControlsUSA.com